
FAQ71C

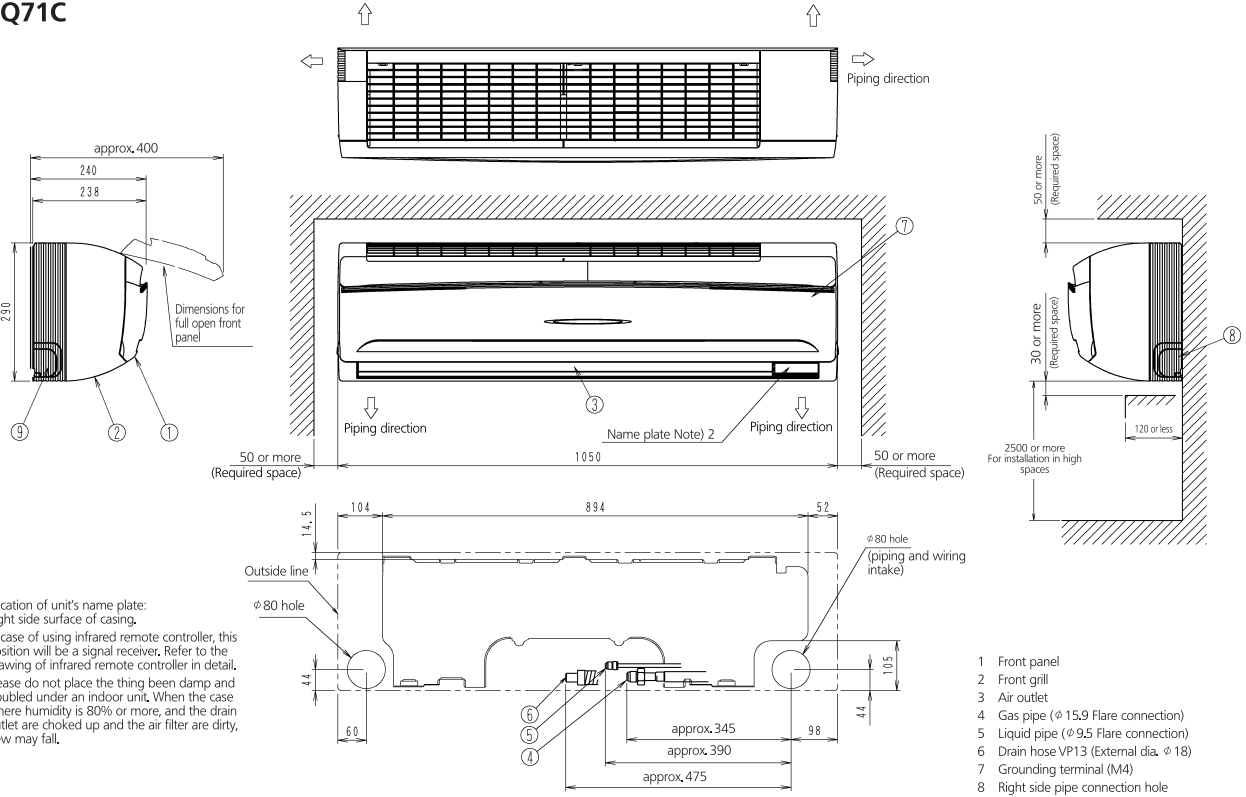

Notes:

1. Location of unit's name plate: Right side surface of casing.
2. In case of using infrared remote controller, this position will be a signal receiver. Refer to the drawing of infrared remote controller in detail.
3. Please do not place the thing been damp and troubled under an indoor unit. When the case where humidity is 80% or more, and the drain outlet are choked up and the air filter are dirty, dew may fall.

1 Front panel
2 Front grill
3 Air outlet
4 Gas pipe (φ15.9 Flare connection)
5 Liquid pipe (φ9.5 Flare connection)
6 Drain hose VP13 (External dia. φ18)
7 Grounding terminal (M4)
8 Right side pipe connection hole
9 Left side pipe connection hole

Mounting location