


NAME

6. PLEASE RESPECT THE DISTANCES AS SHOWN ON FIGURE BELOW.

AA AB

MODEL

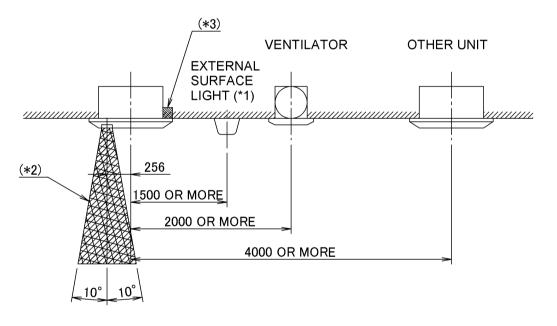

- (*1) DOES NOT COUNT FOR BUILD IN LIGHT.
- (*2) SPACE NEEDED TO ENTER WITH VACUUM-CLEANER TUBE.
- (*3) KEEP THE EXHAUST OF DECORATION PANEL FREE.

NOTES:

1. LOCATION OF THE NAMEPLATES:

HANGING BOLT

4 x M8 - M10

- UNIT BODY: ON THE CONTROL BOX COVER
- DECORATION PANEL: ON THE PANEL FRAME AT THE PIPING SIDE UNDER THE CORNER COVER

840

280

330

4


(1)

340

- 2. WHEN INSTALLING AN OPTIONAL ACCESSORY, REFER TO THE INSTALLATION DRAWINGS
- FOR THE FRESH AIR INTAKE KIT AN INSPECTION PORT IS NECESSARY
- 3. MAKE SURE THE SPACING BETWEEN THE CEILING AND THE CASSETTE IS NO MORE THAN 35mm MAX. CEILING OPENING: 910mm
- 4. WHEN THE CONDITIONS EXCEED 30°C AND RH 80% IN THE CEILING OR FRESH AIR IS INDUCTED INTO THE CEILING, AN ADDITIONAL INSULATION IS REQUIRED (POLYETHYLENE FOAM, THICKNESS 10mm OR MORE)
- 5. IN CASE OF USING A SENSOR KIT, THIS POSITION WILL BE A SENSOR. REFER TO THE DRAWING OF THE SENSOR KIT FOR MORE DETAIL

5. INSTALLATION DIRECTION


(SEE NOTE 3)

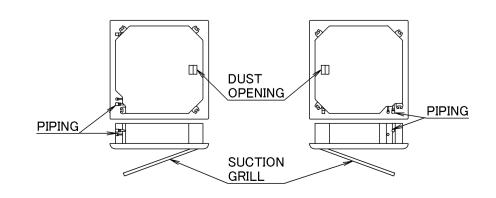

840

35

(SEE NOTE 3)

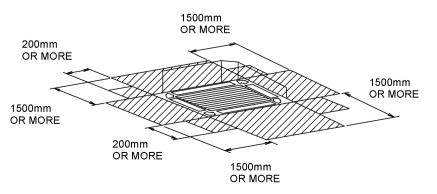

REQUIRED SPACE

IN CASE A DISCHARGE OPENING IS CLOSED WITH THE 'SEALING MEMBER' OPTION, THE DISTANCE OF 1500mm CAN BE REDUCED TO 500mm ON THE CLOSED SIDE.