Panasonic



5097

EBLNet license

Fire alarm solutions
technical description

www.panasonic-fire-security.com

TABLE OF CONTENTS

1. INTRODUCTION 3
2. ABBREVIATIONS 3
3. EBLNET KEY 4
4. SDK 5

1. INTRODUCTION

This document describes the EBLNet license, type number 5097.
The EBLNet license kit is containing:

- EBLNet license number document
- EBLNet license number label
- User instructions


2. ABBREVIATIONS

CIE	Control and indicating equipment	= control unit
SDK	Software Developers Kit	


3. EBLNET KEY

A new EBLNet key is required for installation of a new Web-server or Gateway, an earlier installed unit, or a replaced unit.

It is important that EBLNet is “activated” in the Web-server / Gateway.
This is done in EBLWin, in the Web-server / Gateway Properties dialogs.

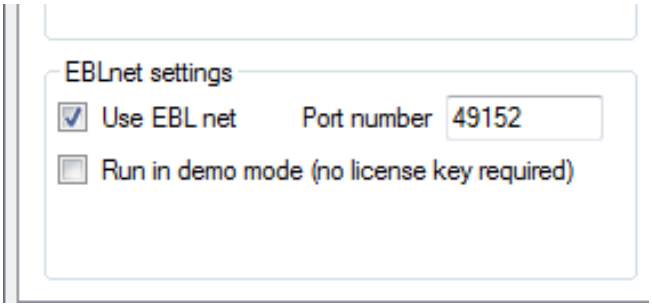

Go to www.panasonic-fire-security.com and press **License Form** to open the form:

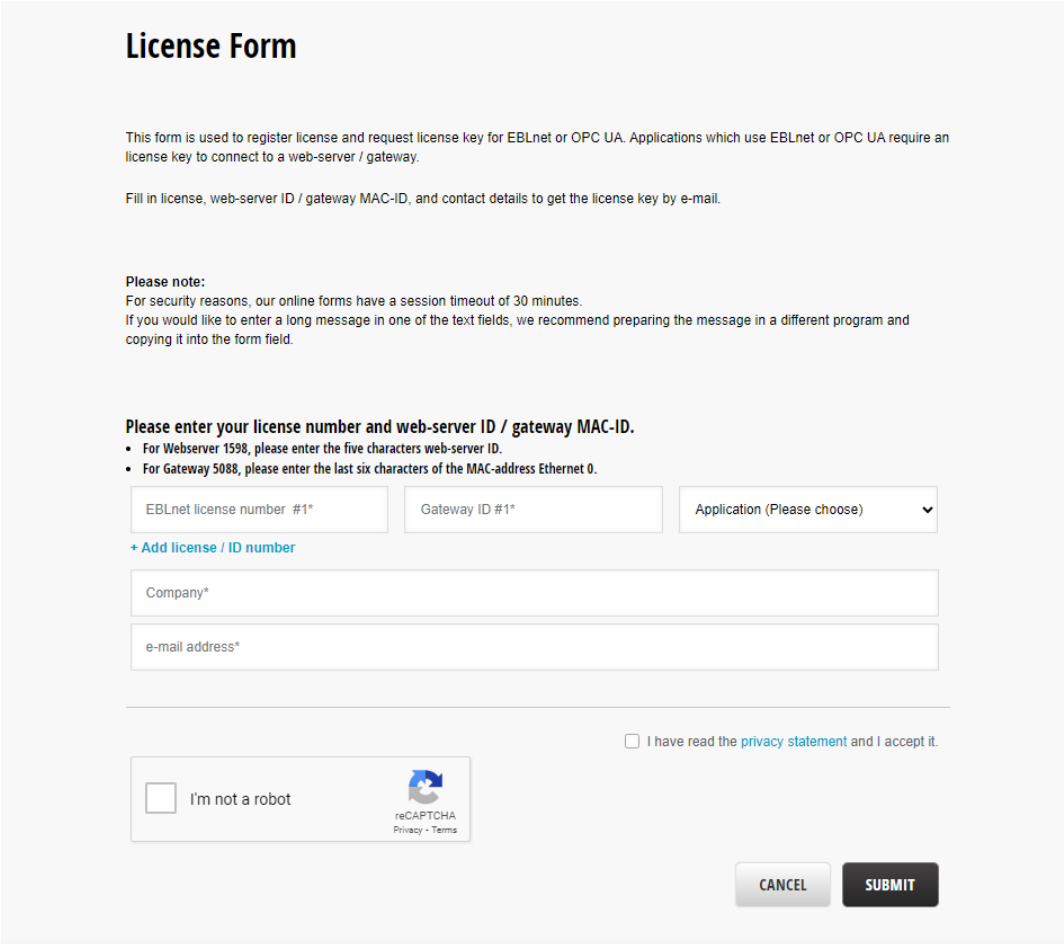


a) Fill in the form:

- EBLNet license number; see the attached EBLNet license document or the EBLNet license number label.
- Web-server ID; see the label on the Web-server

OR

- Gateway MAC-ID; see the label on the Gateway (last six characters)



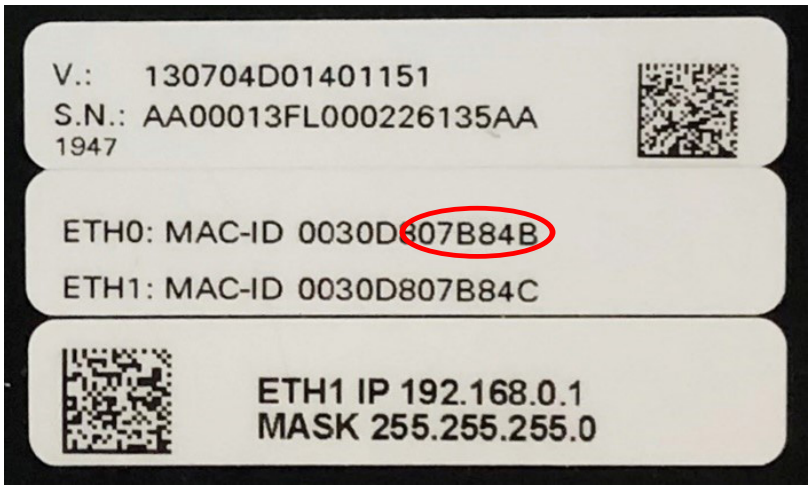

- Company; name of the ordering company, installation name, etc.
- e-mail address; to whom the EBLNet key will be sent

Press + to add one more EBLNet license number and Web-server ID / Gateway MAC-ID.

b) Check the Privacy statement checkbox.
c) Press Send.
d) Place the EBLNet license number label in the CIE close to the Web-server / Gateway.

The EBLNet license number should be possible to read.

The EBLNet key will be sent to the email address written in the EBLNet key request form.

The EBLNet key has to be entered in the Security Management system when connecting it to the Web-server / Gateway. See the instructions for the Security Management system.

4. SDK

The SDK is used to develop a security management system using EBLnet.
The SDK consist of EBLnet redistributables, documentation and examples.

- Some development environment that can target Microsoft .NET Framework, version 3.5
- To make best use of the examples, Visual Studio 2010 is recommended
- To view the documentation, a Microsoft HTML Help compatible viewer is needed

It is included in the EBLnet file downloaded from www.panasonic-fire-security.com. Go to Downloads / Software / Others / EBLnet.

DOCUMENT NAME: TECHNICAL DESCRIPTION 5097
DOCUMENT NUMBER: MEW01986 EN
DATE OF ISSUE: 2016-11-03
REV: 3
DATE OF REVISION: 2024-03-18

Panasonic Fire & Security Europe AB
Jungmansgatan 12
SE-211 11 Malmö
SE
Tel: +46 (0)40 697 70 00